


NANO T

- Track mounted LED luminaire
120 VAC, 0.47A, 60 Hz, 55 W
- For use with Lytespan Track Lighting System, Single-Circuit

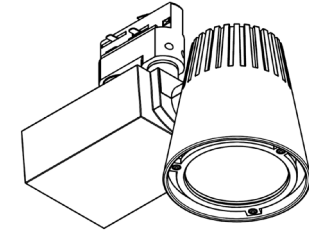

IMPORTANT SAFETY INSTRUCTIONS - SAVE THESE INSTRUCTIONS

Read all instructions before installing luminaire.

Track lighting systems are intended for installation in dry locations only (damp or wet installation will void warranty).

Caution - To reduce the risk of fire and electric shock, use only with Track System : Lightolier / Lytespan Track Lighting System.

INSTALLATION

1. Hold luminaire by the mounting adapter. Insert contact head into Power-Trac. Twist mounting adapter approximately 1/4 turn (90°) until mounting sleeve tab locks into Power-Trac opening.
Note : Forcing mounting adapter in wrong direction may damage the contact assembly ! If mounting adapter will not turn easily, twist adapter in opposite direction. Polarity line on adapter must align with polarity line on Power-Trac for proper installation.
2. To remove the luminaire you have to pull down on mounting adapter sleeve until tab is free of track channel opening. Twist mounting adapter 1/4 turn (90°) until contact head is free and remove luminaire from track.

